

UNIVERSITY of WASHINGTON

UW-IT

FACILITIES PLANNING AND DESIGN

2 RACK LAYOUT

SCHEDULE A
CAMPUS
STANDARD

REV.: 3

DATE: 7/31/17

REV. BY: J. Templin

DRN. BY: E. SHINE

CHECK: D. GAGE

APPR: J. EVANS

DATE: 10/14/14

SCALE:

(11x17)


1" = 1'-0"

CAD NAME:

RK-CI-2A.DWG

DWG. NO.:

RK_CIF-2A.1

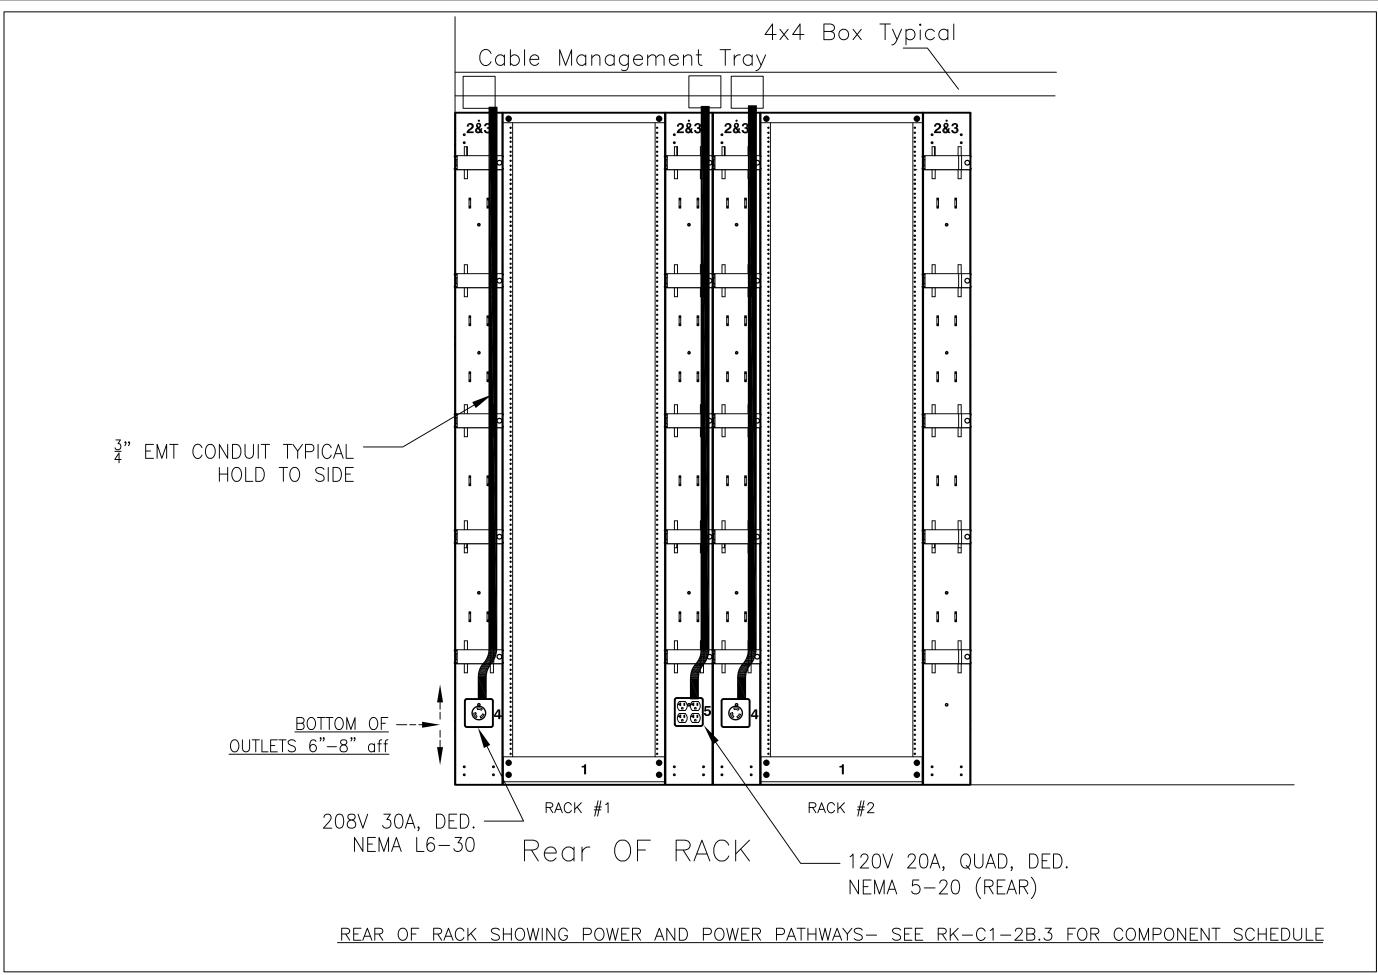

UNIVERSITY of WASHINGTON

UW-IT

FACILITIES
PLANNING
AND
DESIGN

2 RACK LAYOUT

SCHEDULE A
CAMPUS
STANDARD

REV.: 4

DATE: 7/12/18

REV. BY: J. Templin

DRN. BY: J. Templin

CHECK: R. Aguilar

APPR: L. Zimmerman

DATE: 12/20/16

SCALE:

(11x17)

1" = 1'-0"

CAD NAME:

RK-CI-2A.DWG

DWG. NO.:

RK_CIF-2A.2

	RACK C	OMPONENTS — SCHEDULE A	
LAYOUT NUMBER	COMPONENT	REQUIRED PRODUCT	RACK HEIGHT (PER UNIT)
1	RACK	Cooper B-Line SB556084XUFB	84" - 45U
2	VERT. CABLE MGMT.	Corning CDF-IBU-7-6	6"W x 84"H
3	CABLE MGMT. HUB	Corning CDF-HUB-05	N/A
4	208V NEMA L6-30	NEMA L6-30 Receptacle, Dedicated	N/A, REAR MOUNT
5	120V NEMA 5-20	NEMA 5-20 Quad Receptacle, Dedicated	N/A, REAR MOUNT
6	WATERFALL	Chatsworth 12183-719	2U
7	POWER STRIP	Provided by UW-IT, RESERVE SPACE	10
8	OSP FIBER (96 STRAND)	Corning Pretium EDGE FX EDGE—01U—FP with EDGE—CS12—AE—P00RJ splice cassettes and EDGE—CDF—RJ12—BKT strain relief bracket	10
9	RISER FIBER	Corning Pretium EDGE FX EDGE—01U—FP with EDGE—CS12—AE—P00RJ splice cassettes and EDGE—CDF—RJ12—BKT strain relief bracket	10
10	EDGE SWITCH	Provided by UW-IT, RESERVE SPACE	10
11	HORIZ. CABLE MGMT.	Provided by UW-IT, RESERVE SPACE	1U
12	VC AGG SWITCH	Provided by UW-IT, RESERVE SPACE	10
13	HORIZ. CABLE MGMT. 2	Hubbell HC219ME3N	2U
14	PATCH PANEL	Commscope Systimax PM-PS-48	3U
15	VOICE TRANSITION	Commscope Systimax PM-PS-48	3U
16	UPS	RESERVE SPACE FOR DEPARTMENTAL INSTALL	3U
17	WIRELESS Patch Panel	Commscope Systimax M2000-48	2U

LAYOUT NOTES:

- 1. CAMPUS APPLICATIONS REQUIRE (1) 208V 30A

 DEDICATED POWER OUTLET PER RACK AND (1) QUAD

 DEDICATED 120V 20A POWER OUTLET.
- 2. POWER OUTLETS ARE MOUNTED REAR-FACING IN THE BACK OF THE VERTICAL CABLE MANAGEMENT UNITS, 8" AFF.
- 3. POWER STRIPS TO BE INSTALLED REAR-FACING.
- 4. (2) VERTICAL WIRE MANAGERS PER RACK RECOMMENDED. FINAL DESIGN BASED UPON CABLE DENSITY AND SPACE AVAILABILITY.
- 5. RACKS TO BE TIED TO GROUND BUS BAR.
- 6. PATCH PANEL INSTALL BEGINS AT 28U FROM THE BOTTOM AND EXPANDS <u>DOWN</u>. EDGE SWITCH AND ASSOCIATED CABLE MANAGEMENT BEGINS AT 28U FROM THE BOTTOM AND EXPANDS <u>UP</u>.
- 7. REFER TO <u>CABLE PATH GUIDE</u> FOR CABLE PATH INSTALLATION REQUIREMENTS.

 CABLE ROUTING TO BE SPLIT AT CENTER.
- 8. FINAL RACK LAYOUT, PRODUCTS, AND PROJECT SPECIFICATIONS TO BE CONFIRMED AND APPROVED BY OWNER.
- 9. TOP OF HORIZONTAL CABLE MANAGER AT 14U FROM BOTTOM OF RACK.
- 10. SECOND POWER STRIP REQUIRED IN RACK SERVING V.C. SWITCHES IN MDF.



UW-IT

FACILITIES PLANNING AND DESIGN

2 RACK LAYOUT

SCHEDULE A
CAMPUS
STANDARD

REV.: 3

DATE: 7/31/17

REV. BY: J. Templin

DRN. BY: E. SHINE CHECK: D. GAGE

APPR: J. EVANS

DATE: 10/14/14

SCALE:

NTS

CAD NAME:

RK-CI-2A.DWG

DWG. NO.:

RK_CIF-2A.3